


San Diego Rural Fire Protection District

Guidelines for Fire-Resistive Construction in Wildland/Urban Interface Areas

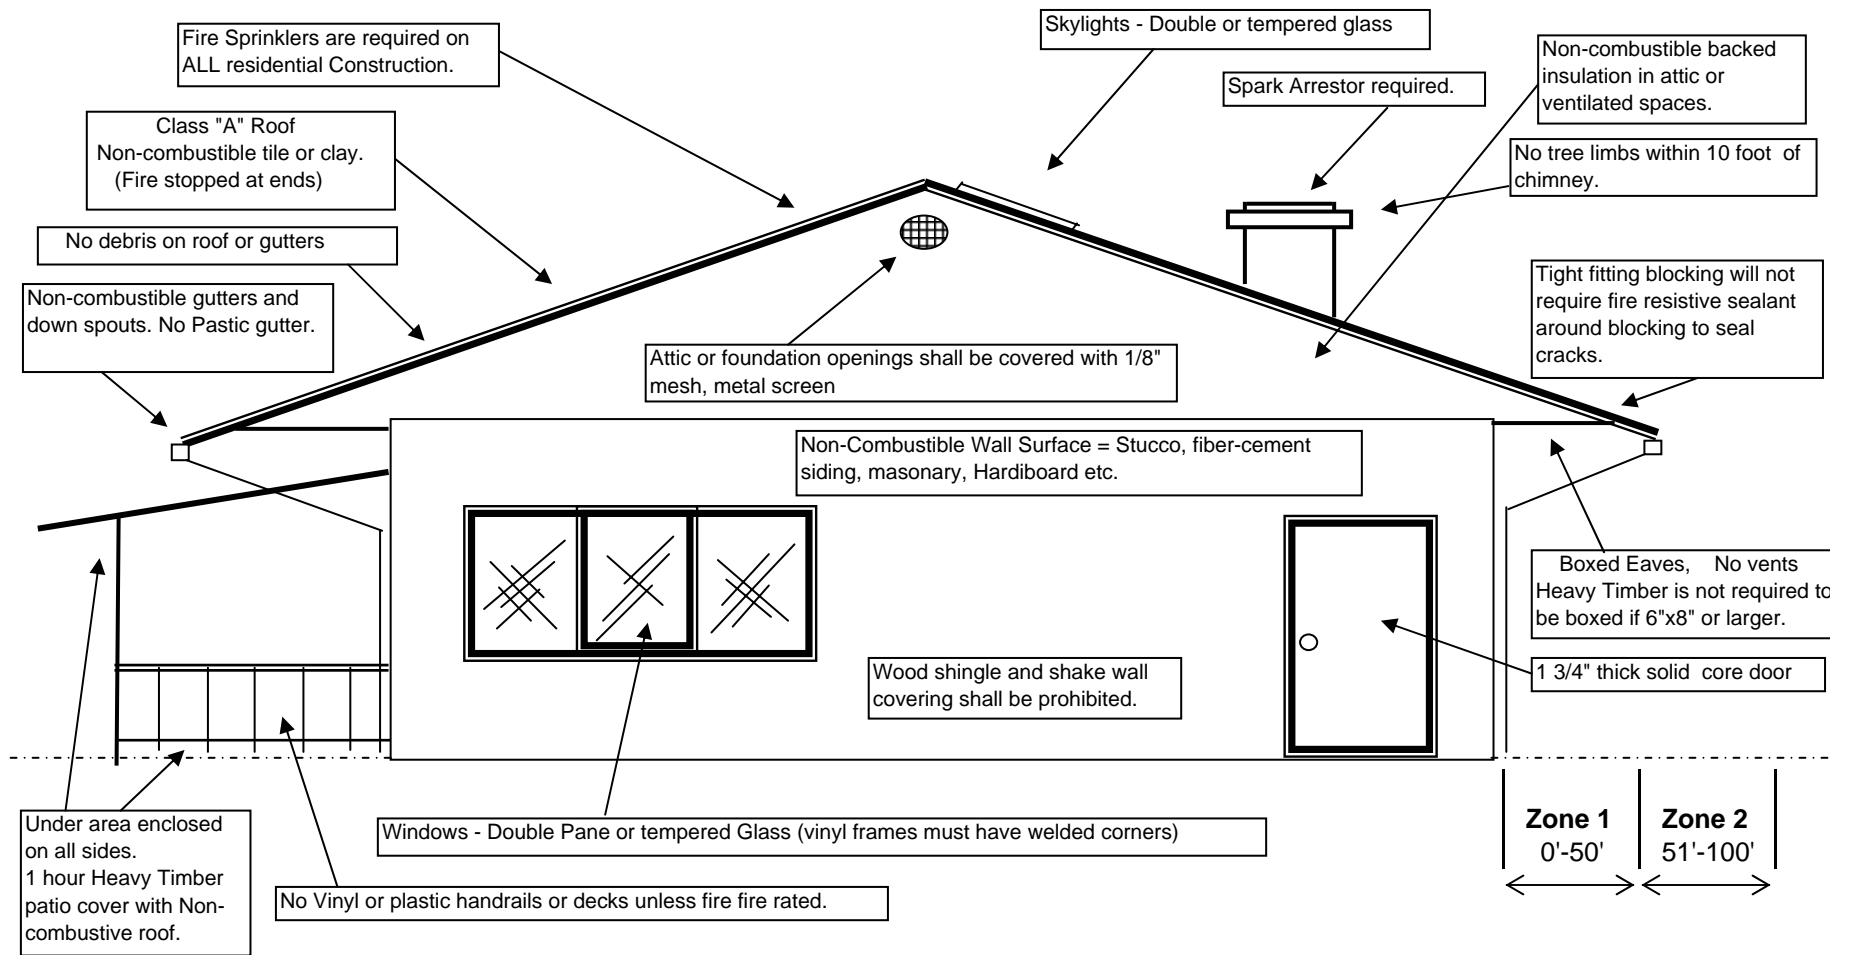

ZONE 1 = This zone includes the area from any building to point 50 feet away. This zone must be cleared and planted with fire resistive plants.

ZONE 2 = This zone is between 51 to 100 feet from building. In this zone the native vegetation may remain but it must be thinned by 50% and all dead and dying vegetation must be removed. (Fuel Modification) The modification of the vegetation will slow down fire spread